


מושחל בצינור - EXTERNAL SENSOR  
 פלסטי מתאים (OPTION)  
 (TS05 or TS06 ONLY!)

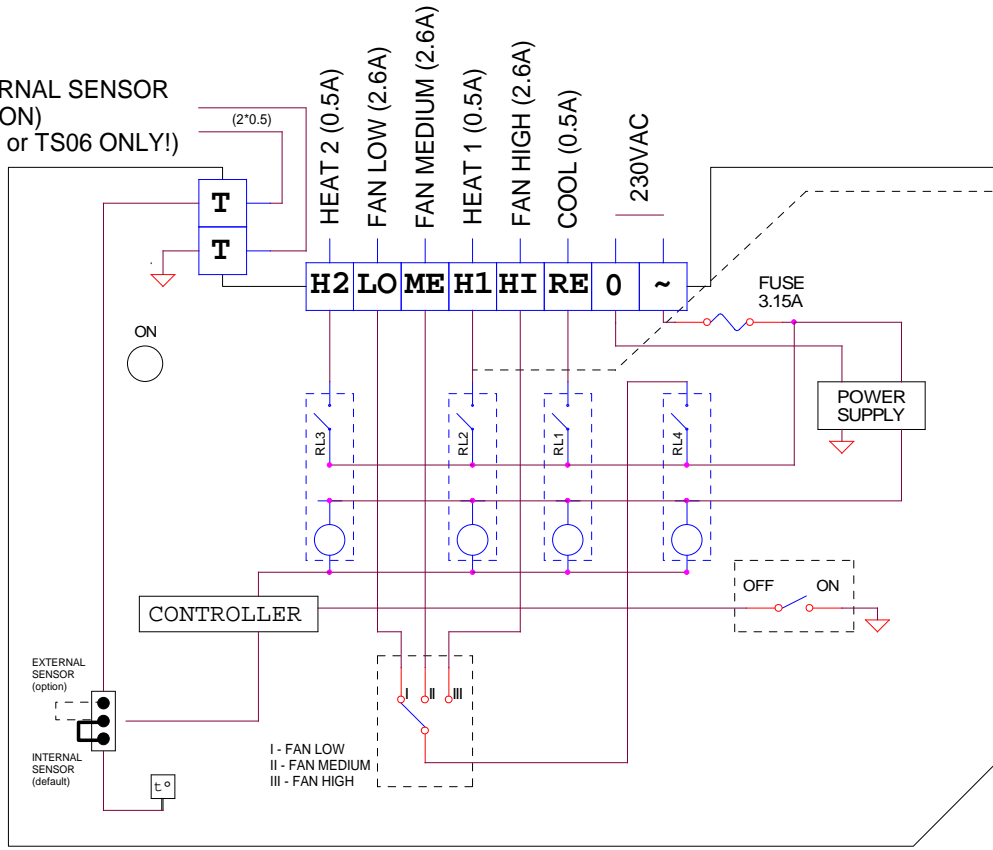

AFTER START, BOTH  
 RE+H1 OPERATE FOR  
 4 MIN. EVERY 1 HOUR

**meitav-tec**

Tel: 03-9626462 Fax: 03-9626620  
 email: support@meitavtec.com

Title:	<b>EP6/220/01</b>
Date:	27/08/2008
DWG No.	10260

No.	Revision
2	Fan Delay , Fix Switch 3 speed
1	Original

Date	27.08.08	Print name:	EP4-6 220V	Drawn:	Marina
	05.07.06	Software name:	EP6EX02	Checked:	Alex
		Check sum:	8B05	Approved:	Elan
		File name:	EP6-220-01.DSN		